




Variation of pH at Source pumps (2011)

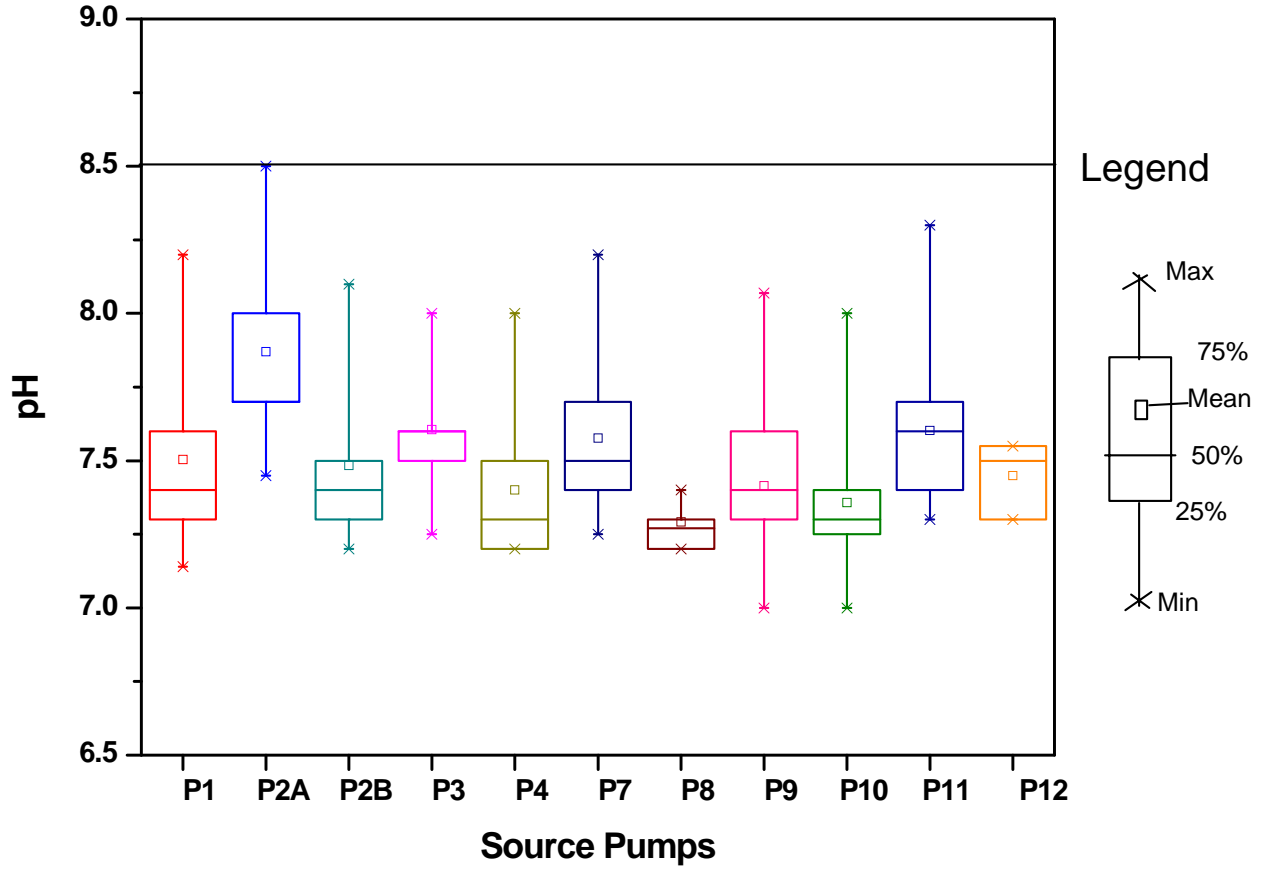

Variation of Total Dissolved Solids at Source Pumps (2011)

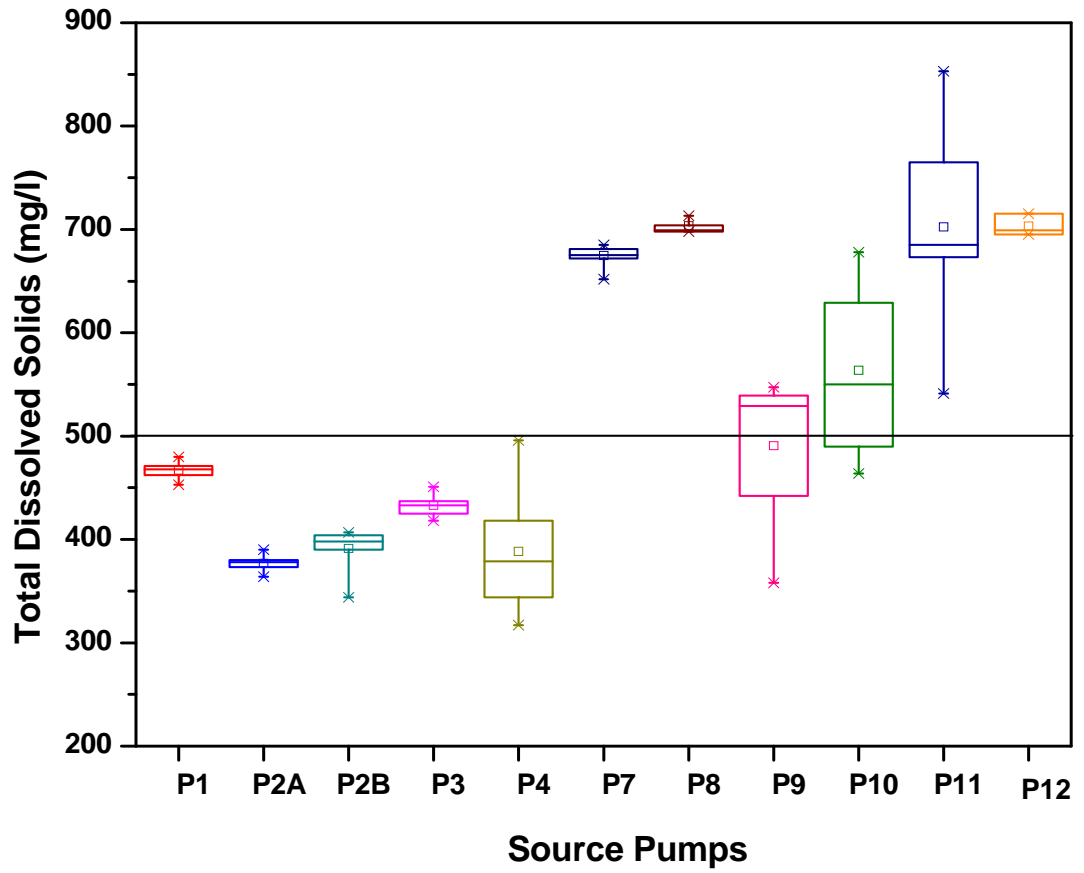

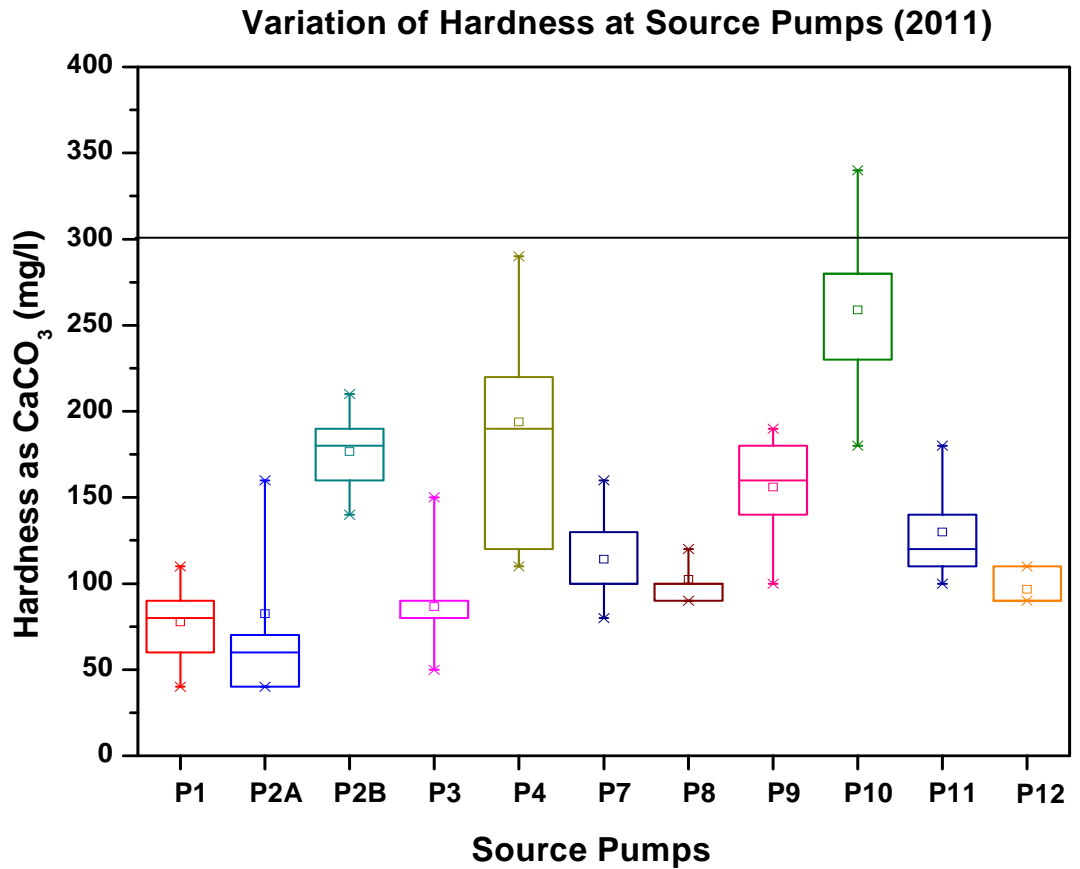

**Remarks:**

Variation of pH, Hardness and TDS for the year 2011 (n= 11 months) are shown above. All other parameters are not shown as they were found to be within permissible limits and most of the heavy metals were found below detection limits.

It should be noted that the TDS of all the samples from pumps P7, P8, P11 and P12 were above the permissible limit of 500 mg/l. However, all the parameters were within the maximum limits.